



UNIVERSAL POLYMERS CORPORATION

A Division of General Manufacturing Coatings Corp.

APPLICATION GUIDE

Residential Attics



3001 E. Pioneer Pkwy | Arlington, TX 76010 | Office: 682.503.8069 | Tech Support: 203.760.0025

www.upcfoam.com



UNIVERSAL POLYMERS CORPORATION

A Division of General Manufacturing Coatings Corp.

OVERVIEW

The purpose of UPC's Application Guide for Residential Attics is to provide the installer and specifier with the knowledge necessary to safely and effectively install UPC spray foam products in residential attics. While we make every effort to include the technical information most needed for typical residential attic installations, we cannot account for every type of attic assembly and situation. We also cannot detail every type of application scenario and condition. We encourage applicators and specifiers to contact our technical and building science support at: 203-760-0025. While this guide can provide in depth design and application instruction, it cannot replace the practical need for hand-on installation experience. UPC has technicians available for application training and support.

TABLE OF CONTENTS

Description	2	Substrate Preparation	15-17
Definitions	2-3	Environmental Limitations	17
Basic Building Science of Attics	4-6	Limitation of Use Summary	18
Benefits of Using SPF in Residential Attics	7	Start Up & Shut Down Procedure	19
Code References & Requirements by Zones	8-9	Factors Effecting Yield	21
Climate Zone Map & R-Value Requirements	9	Application Technique	21
Approvals & Certifications	10	Thickness of Pass Limitations	22
Thermal Barrier Protection Requirements	10-11	Quality Assurance Testing Procedures	22-23
Job site Setup Best Practices	12	Troubleshooting	24
Chemical Storage Requirements	13	Material Changeover Procedure	25-29
Isolation & Ventilation Best Practices	13	Drum Disposal	29
PPE Requirements	14	Chemical Waste Disposal	29
Safety Considerations	14	Spill Containment & Clean-Up	30
Special Considerations	14-15	Contacts & Links	30

DISCLAIMER

Published Technical data and instructions are subject to change without notice. Contact your local UPC representative or visit our website at www.upcfoam.com for current technical data and instructions. All guidelines, recommendations, statements, and technical data contained herein are based on information and tests we believe to be reliable and correct, but accuracy and completeness of said tests are not guaranteed and are not to be construed as a warranty, either expressed or implied. It is the user's responsibility to satisfy himself, by his own information and tests, to determine suitability of the product for his own intended use, application, and job situation. User assumes all risk and liability resulting from his own use of the product. Neither seller nor manufacturer shall be liable to the buyer or any third party for any injury, loss or damage directly or indirectly resulting from use of, or inability to use, the product.



DESCRIPTION

Spray Applied Polyurethane Foam (SPF) is commonly used in attics as an insulation and sealant on the floor of the attic creating a “vented attic assembly” or as insulation on the underside of the roof deck and knee walls to create an “unvented attic assembly”. How the customer intends to use the attic will determine where you install the insulation.

If the mechanical ventilation ducting or equipment is located in the attic or the client wants to use the attic for storage, it’s recommended to extend the thermal envelope to include the attic by applying SPF on the underside of the roof sheathing and removing all insulation and penetration sealing from the floor of the attic. This will “connect” the attic space and living space and extend the thermal envelope from the lower walls to the roof ridge giving you a more comfortable space in the attic and protecting your mechanical equipment and ducting from extreme temperatures.


DEFINITIONS

Attic	A space immediately below the roof of the building
AHJ - Authority Having Jurisdiction	An organization, office, or individual responsible for enforcing the requirements of a code or standard.
Building Code	A collection of regulations adopted by a city to govern the construction of buildings.
Dew Point	The atmospheric temperature (varying according to pressure and humidity) below which water droplets begin to condense, and dew can form.
Exotherm	Heat generated by a compound when undergoing change or formation.
Exothermic Reaction	A reaction, creation or destruction which gives off heat.
Ignition Barrier	A material which is applied directly to a combustible material to eliminate The potential for ignition from minor heat sources and incidental spark, flame, or heat source, meeting the specific criteria as tested.
Primer	A substance used as a preparatory coat on previously unpainted substrate, to prevent the absorption of subsequent layers of paint or the development of rust.
R-Value	The capacity of an insulating material to resist heat flow.
Thermal Barrier	An element of low thermal conductivity placed in an assembly to reduce or prevent the flow of thermal energy between conductive materials.



DEFINITIONS (CONT)

Thermal Envelope	The exterior or shell of a building that repels the elements.
Thermal Resistance	The ability of a material to resist the flow of heat energy across a stated thickness and temperature.
Vapor Barrier	A material with a perm rating less than 0.1.
Vapor Semi-Permeable	A material with a perm rating between 1 and 10, which allows a small amount of moisture infiltration.
Vapor Permeable	A material with a perm rating over 10 which allows moisture to pass relatively easily.
Class I Vapor Barrier/Retarder	A material with a perm rating less than 0.1.
Class II Vapor Retarder	A material with a perm rating between 0.1 and 1.0.
Class III Vapor Retarder	A material with a perm rating between 1.0 and 10.0.
Vented Attic Assembly	The attic space is connected to the outdoor environment. The Thermal envelope (insulation layer) ends at the attic floor.
Unvented Attic Assembly	The attic space is connected to the conditioned space. The thermal envelope (insulation layer) extends to the roof of the structure.
Vented Roof Assembly	The roof sheathing and roof covering (shingles) is vented above or below the roof sheathing.
Unvented Roof Assembly	The roof sheathing and roof covering (shingles) is in direct contact with the interior insulation as part of an unvented attic assembly. The assembly does not include a space for air.

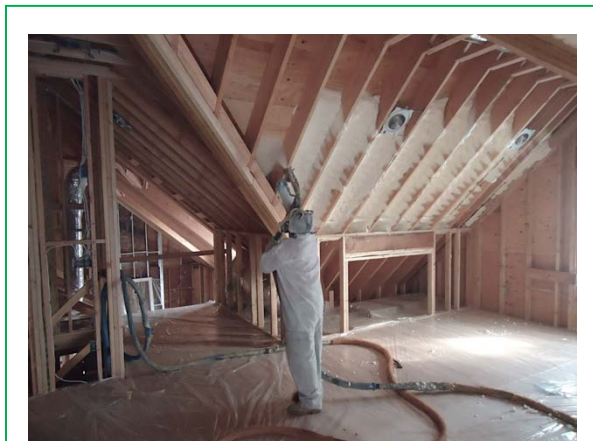





BASIC BUILDING SCIENCE - ATTICS

Attics have two basic designs either vented or unvented. Attics are not cathedral ceilings. Attics are typically defined by a flat floor (ceiling of the living space below) formed by the lower chord of the truss or framing member with the thermal barrier installed in the underside of the lower chord. The thermal barrier is typically gypsum board and serves as the air barrier for the attic assembly. In trussed assemblies, the exterior roof sheathing is fastened to the exterior side of the upper truss chord and either vented or not vented. This is referred to as a vented or unvented roof assembly – different than the vented or unvented attic assembly.

In vented attic assemblies, the attic space is coupled to the exterior environment through ridge, soffit and gable vents. The thermal envelope of the home ends at the floor of the attic and the attic assembly above the floor provides physical protection and esthetic appeal. The drawing below illustrates a vented attic assembly.

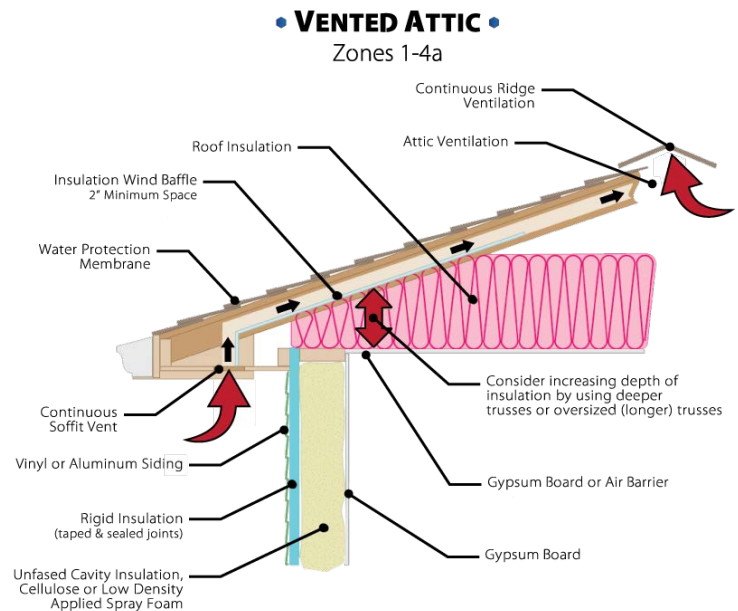

• UNVENTED ATTIC • Zones 1-4a

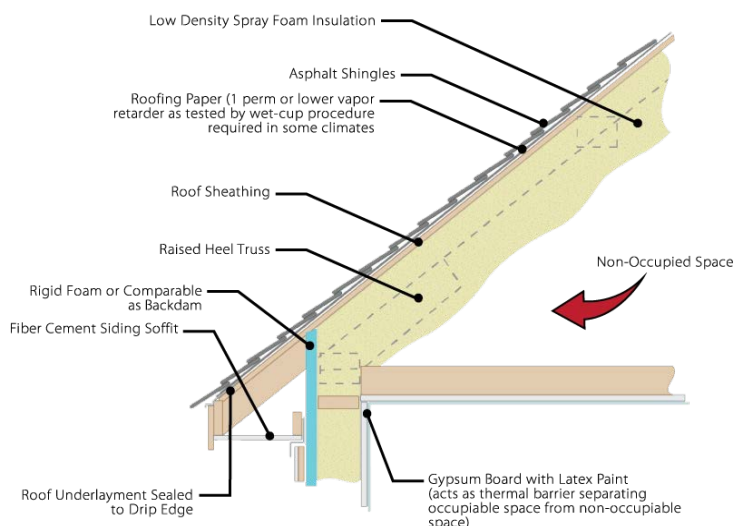

In unvented attic assemblies, the thermal envelope is continued from the lower-level walls up through the energy plates and risers (knee walls) onto the underside of the roof sheathing to fully encapsulate the attic space. The floor of the attic is left uninsulated. All soffit, ridge and gable vents are eliminated. The attic is now considered a component of the conditioned space. The drawing below illustrates an unvented attic assembly.



UNIVERSAL POLYMERS CORPORATION

A Division of General Manufacturing Coatings Corp.

There are several Building Science considerations when installing UPC SPF (open or closed cell) in an attic assembly. In all cases, the occupied living space below the attic floor must include an approved 15-minute thermal barrier. ½ inch gypsum board is typical.

VENTED ATTIC ASSEMBLIES

In Climate Zones 6, 7 and 8, if permeable, open cell SPF is used on the floor in a vented attic design, there must be a continuous class II vapor retarder (barrier in some cases) installed on the warm side (conditioned side) of the assembly to protect the insulation from contact with warm, humid air from the occupied space. Warm, humid air will condense within permeable insulation and may result in rot, mold, and premature structural failure. In all climates, when installing open cell SPF, confirm a continuous air barrier is installed at the ceiling line to isolate the insulation from the conditioned space. Closed cell foam may be installed on the floor of a vented attic assembly in any climate zone without additional air or vapor retarder installed on the warm side of the assembly. Vented attic assemblies should not communicate with the conditioned space. All penetrations through the attic floor must be sealed. Always confirm the R-value requirements (thickness of foam) with local Building Codes and the local AHJ.



UNVENTED ATTIC ASSEMBLIES

As the thermal envelope is now extended to include the underside of the roof assembly, all insulation and penetration seals are removed from the attic floor and the attic is allowed to communicate with the conditioned space below. Depending on intended occupancy and use of the attic space, specific requirements and allowances are stated in the local code regarding the extent of thermal protection (fire protection) required.

In climate zones 4a marine and above, any open cell SPF must be protected with an additional vapor retarder installed on the inside (warm side) of the insulation to eliminate the potential for moist air to travel through the permeable insulation and condense on the underside of the roof sheathing. If in doubt, UPC recommends conducting a hygrothermal analysis of the assembly (Condensation Potential Model) in order to confirm the intended assembly does not contribute to the potential to form condensation within the assembly. The analysis can then be presented to the local AHJ for review and approval. Failure to confirm the acceptability of the proposed assembly (contradicting the local code) with the AHJ places the installer/contractor at risk for replacement.

Closed cell foam may be installed on the underside of roof sheathing without the need for additional vapor retarders in any climate zone.

Always confirm the R-value requirements (thickness of foam) with local Building Codes and the local AHJ.



VENTED & UNVENTED ROOF ASSEMBLIES

Let's look closely at the roof covering assembly itself. This is the roof, not the attic. The roof covering is subjected to the extremes of the environment, temperature, sunlight, wind, rain and hail all work to shorten the lifespan of the cladding. Shingles are frequently used and come in many colors and varieties of design. Warranties vary from 5 to 50 years and each manufacturer provides the limitations and inclusions of the warranty on their website. Before installing open or closed cell SPF onto the underside of the roof sheathing, check the warranty limitations and exclusions of the cladding system being installed or currently in-place. There may be warranty impacts associated with a non-vented roof assembly.

If a vented roof assembly is required, the use of vent baffles or chutes is recommended. Simple baffles or chutes can be installed (stapled) directly onto the underside of the roof sheathing between the truss or rafter upper chords to provide an airspace between the SPF and the underside of the roof sheathing. SPF can then be applied directly onto the baffles at the required thickness. When polystyrene chutes/baffles are installed, it is recommended to reduce the first pass thickness of closed cell SPF to 1 inch to avoid deforming the baffle.



Notice, venting can be provided above or below the roof sheathing.

Studies have shown the need for a vented roof assembly is unwarranted. Concerns of increased covering (shingle) temperature are more dependent upon shingle color than the ability to dissipate heat inward through the assembly.





BENEFITS OF USING SPF IN RESIDENTIAL ATTICS

SPF is an excellent sealant and is the most effective common insulation available. When applied directly to the floor of the attic as part of a vented attic assembly, SPF seals all penetrations and forms a continuous, fully adhered, durable, insulated attic floor. Unlike loose-fill or blown products, SPF is sprayed directly onto the surface and sticks wherever it's applied. It doesn't settle and can't be blown around by wind passing through soffit vents or floor penetrations. Either variety of SPF, open cell or closed cell, can be installed directly onto the floor of the attic. Consideration must be given to local building and energy codes when determining how much (how thick) and which type (open or closed cell) SPF is best suited for the specific building location. Always refer to the code.

When SPF is installed on the underside of the roof sheathing and knee-walls or energy truss walls to extend the thermal envelope up and around the attic, a non-vented assembly is created. This design provides a semi-conditioned space in the attic. The living space below and the attic are now "connected" as there is no insulation on the floor of the attic and the floor penetrations are not sealed. The mechanical equipment and air ducting now rest comfortably in a controlled space and last longer as they don't have to work as hard. The attic space is now available to be used as storage or an additional living space once local building and energy code requirements are met. Always refer to the code.

In areas of high fire potential – forested areas, when an unvented attic assembly is used, burning embers will not enter the attic space through soffit or ridge vents. In high wind areas, wind-driven rain will not enter the envelope through open vents and the insulation is not blown around the attic if the soffit and ridge vents are eliminated.

Studies have shown the unvented attic assembly is far more energy efficient in all climate zones. Simply providing a continuous air barrier in the attic space with UPC SPF can reduce energy consumption by up to 15%.

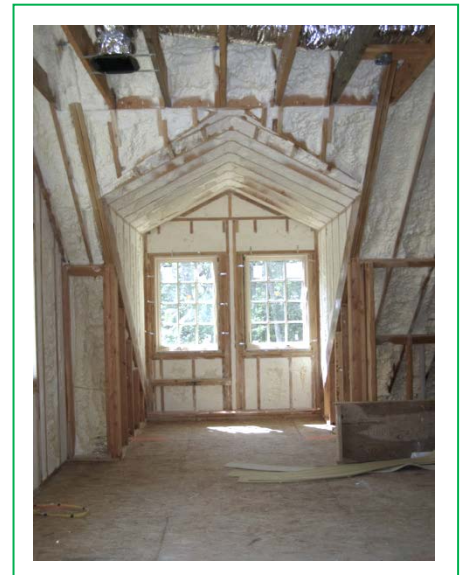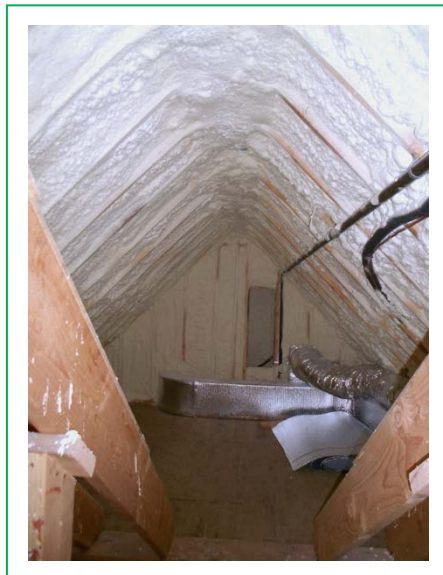



CODE REFERENCES & REQUIREMENTS BY ZONE, FIRE PROTECTION & VAPOR RETARDER REQUIREMENTS

Local Building (IBC) and Energy Codes (IECC) will provide the minimum requirements for insulation thickness – expressed as R or U value, the level of fire protection (thermal protection) required for the application and the need for additional vapor retarders based on the geographic location of the building and the type of SPF used. Closed Cell SPF (ccSPF) is considered a type II vapor retarder – semi permeable, while Open Cell SPF (ocSPF) is *always* vapor permeable.

The chart below shows the American Society of Heating, Refrigerating and Air- Conditioning Engineers (ASHRAE) Climate Zones in the U.S. These zones are used to determine the level of insulation required to eliminate the potential to form condensation within the assembly under “normal” conditions. The Building Code (IECC and IBC) use this chart to establish the minimum insulation requirements for various assemblies including attics and ceilings. Local Building and Fire Officials (AHJ – Authority Having Jurisdiction) should always be consulted to confirm the requirements before installing any insulation.

Chapter 4 of the International Energy Conservation Code (IECC) entitled “Residential Energy Efficiency” specifically identifies the level (R-value) and type (cavity or continuous) of insulation required to meet the minimum requirements of the Building Code. The chart below is taken from the 2018 IECC. Always understand and confirm the specific requirements of the Building Code and Energy Code in effect in the project area. The version (year) of various codes vary dramatically from state to state. Local Building and Fire Officials (AHJ – Authority Having Jurisdiction) should always be consulted to confirm the requirements before installing any insulation.

TABLE R402.1.2 INSULATION AND FENESTRATION REQUIREMENTS BY COMPONENT

CLIMATE ZONE	FENESTRATION U-FACTOR ^b	SKYLIGHT ^b U-FACTOR	GLAZED FENESTRATION SHGC ^{b,a}	CEILING R-VALUE	WOOD FRAME WALL R-FACTOR	MASS WALL R-VALUE ⁱ	FLOOR R-VALUE	BASEMENT ^c WALL R-VALUE	SLAB ^d R-VALUE & DEPTH	CRAWL SPACE ^e WALL R-VALUE
1	NR	0.75	0.25	30	13	3/4	13	0	0	0
2	0.40	0.65	0.25	38	13	4/6	13	0	0	0
3	0.32	0.55	0.25	38	20 or 13+5 ^h	8/13	19	5/13 ^f	0	5/13
4 Except Marine	0.32	0.55	0.40	49	20 or 13+5 ^h	8/13	19	10/13	10, 2 ft	10/13
5 and Marine 4	0.30	0.55	NR	49	20 or 13+5 ^h	13/17	30 ^g	15/19	10, 2 ft	15/19
6	0.30	0.55	NR	49	20+5 ^h or 13+10 ^h	15/20	30 ^g	15/19	10, 4 ft	15/19
7 and 8	0.30	0.55	NR	49	20+5 ^h or 13+10 ^h	19/21	30 ^g	15/19	10, 4 ft	15/19

NR= Not Required • For SI: 1 ft=304.8 mm

a. R-Values are minimums. U-Factors and SHGC are maximums. Where insulation in a cavity that is less than the label or design thickness of the insulation, the installed R-Value of the insulation shall not be less than the R-Value specified in the table.

b. The fenestration U-Factor column excludes skylights. The SHGC column applies to all glazed fenestration.

Exception: In climate zones 1 through 3, skylights shall be permitted to be excluded from glazed fenestration SHGC requirements provided the SHGC for such skylights does not exceed 0.30.

c. *10/13* means R-10 continuous insulation on the interior or exterior of the home or R-13 cavity insulation of the basement wall. *15/19* means R-15 continuous insulation on the interior or exterior of the home or R-19 cavity insulation at the interior of the basement wall. Alternatively, compliance with *15/19* shall be R-13 cavity insulation on the interior of the basement wall plus continuous insulation on the interior or exterior of the home.

d. R-5 insulation shall be provided under the full slab area of the heated slab in addition to the required slab edge insulation R-Value for slabs, as indicated in the table. The slab edge insulation for heated slabs shall not be required to extend below the slab.

e. There are no SHGC requirements in the Marine Zone.

f. Basement wall insulation is not required in warm-humid locations.

g. Alternatively, insulation sufficient to fill the framing cavity and providing not less than and R-Value of R-19.


h. The first value is cavity insulation, the second value is continuous insulation. Therefore, as an example, *13+5* means R-13 cavity insulation plus R-5 continuous insulation.

i. Mass walls shall be in accordance with section R402.2.5. The second R-Value applies where more than half the insulation is on the interior of the mass wall.



UNIVERSAL POLYMERS CORPORATION

A Division of General Manufacturing Coatings Corp.

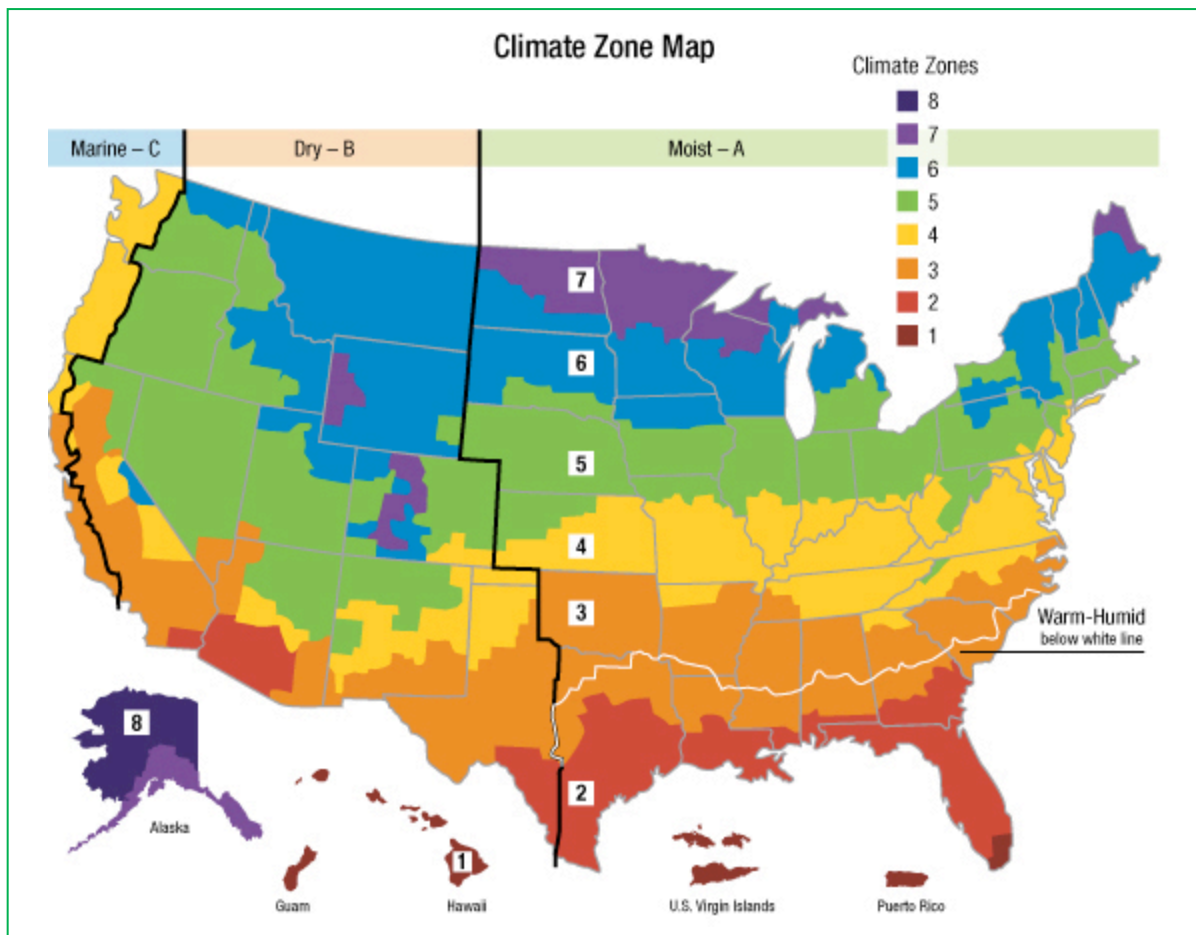

LET'S LOOK AT THE REQUIREMENTS FOR CEILINGS (ATTIC FLOORS) & ATTIC ROOFS, SPECIFICALLY.

UPC PRODUCT THICKNESS REQUIRED (INCHES)

CLIMATE ZONE	R-VALUE	2.0 R & HL	1.7 R	2.0 HL HFO	500 R	500 MAX/PRO	500 OCX
1	30	4.5	4.5	4.5	8	8	8
2	38	6	6	6	10	10	10
3	38	6	6	6	10	10	10
4 Except Marine	49	7.5	7.5	7.5	13	13	13
5 & Marine 4	49	7.5	7.5	7.5	13	13	13
6	49	7.5	7.5	7.5	13	13	13
7 & 8	49	7.5	7.5	7.5	13	13	13



UNIVERSAL POLYMERS CORPORATION

A Division of General Manufacturing Coatings Corp.

APPROVALS & CERTIFICATIONS

All UPC products have been independently tested by a Nationally Accredited laboratory to meet or exceed the requirements of Intertek's Clean Air Gold standard. When properly mixed and installed by approved contractors and installers in accordance with all prevailing building codes, our installation and processing guidelines, as well as industry best practices, the foam produced is inert and will continue to meet the requirements of the Clean Air Gold standard and our product technical data sheet.

All UPC products have been independently tested by a Nationally Accredited third-party laboratory to exceed the requirements of the International Building Code (IBC), International Residential Code (IRC) and the International Energy Conservation Code (IECC) as stated on the product Code Compliance Research Report (CCRR) specific to the product under consideration. Refer to our website, www.UPCFoam.com, for the latest version of the CCRR.

All physical properties of UPC products have been determined by an independent, Nationally Accredited third-party laboratory as provided on our Product Technical Data Sheet.

UPC stands behind its products with a Limited Lifetime Residential Insulation Warranty available to the original homeowner under the terms and conditions stated on the warranty document.



THERMAL BARRIER (FIRE) PROTECTION REQUIREMENTS

In all cases, the foam must be protected by an approved 15-minute thermal barrier or ignition barrier depending on attic accessibility, end-use and code interpretation. Local Building and Fire Officials (AHJ – Authority Having Jurisdiction) should always be consulted to confirm the requirements before installing any insulation.

The intended use of the attic will determine the level of thermal protection required. UPC provides Code Compliance Research Reports (CCRR) for all SPF products. The CCRR identifies the conditions of use and appropriate thermal protection, describes the maximum allowable thickness for the insulation and thickness of the thermal protection as well as the specific Building Code (IBC, IRC, IECC) reference for attics.

Section 5.3 - Thermal Barrier. This section, and subsections, describe the fire protection requirements for SPF when installed in living spaces in two ways – with or without a prescriptive thermal barrier.

Section 5.3.1 - Application with a Prescriptive Thermal Barrier describes the allowable thermal barrier materials (1/2 -inch-thick gypsum board and 25/32-inch-thick wood structural panel) and the maximum thickness of product behind it. This section also identifies the specific IRC/IBC references, Section R316.4 and 2603.4 respectively.



Section 5.3.2- Application without a Prescriptive Thermal Barrier describes alternative Thermal Barrier materials which can be applied over the specific UPC SPF insulation while meeting the requirements of the code. These are usually fluid applied (spray) options. UPC has tested and exceeded the requirements of the IRC/IBC regarding alternative Thermal Barriers with the following materials: DC315 and No Burn Plus ThB. The individual insulation product's CCRR identifies the required thickness (WFT – wet film thickness) of each spray applied Thermal Barrier.

CCRR Section 5.4 - Attics and Crawlspace. This section, and subsections, describe the fire protection requirements of the IRC/IBC when the insulation is installed in non-living spaces, Attics and Crawlspace. The term Thermal Barrier is replaced with the term Ignition Barrier, as the intended purpose of the protective coating is to protect the SPF insulation from incidental contact with sparks and minor hot material, not to provide 15-minute thermal protection under fire load.

Section 5.4.1 - Application with a Prescriptive Ignition Barrier describes the permissible use of the ignition barrier coating provided attic entry is limited to service of utilities.

UPC provides specific signs and placards to be placed by the SPF Installer in obvious locations within the attic to remind the home occupants of attic space limitations. These signs and placards are available on the UPC website.

NO STORAGE ALLOWED
IN ACCORDANCE WITH APPLICABLE CODES

NO SE PERMITE ALMACENAR
DE CONFORMIDAD CON LOS CÓDIGOS PERTINENTES


Homeowner Address
Dirección del propietario de la Casa

City
Ciudad

State
Estado

Contractor Name
Nombre del Contratista

Date
Fecha

 www.upcfoam.com

APPROVED FOR STORAGE
APROBADO PARA ALMACENAR

Homeowner Address
Dirección del propietario de la Casa

City
Ciudad

State
Estado

Contractor Name
Nombre del Contratista

Date
Fecha

Approved Thermal Barrier Coating
Recubrimiento de Barrera Térmica Aprobado

Foam Product
Producto de Espuma

 www.upcfoam.com

THE SPECIFIC CODE REFERENCES ARE ALSO PROVIDED IN THIS SECTION

Section 5.4.2 - Application without a Prescriptive Ignition Barrier describes the limitations of use when the ignition barrier coating is eliminated. Entry is limited to “service of utilities”, the attic is not interconnected with other attic or spaces in the building, the air in the attic is not circulated to other parts of the building, the attic is a “ventilated attic design” and combustion air is provided in accordance with International Mechanical Code (IMC) Section 701.

Section 5.4.3 - Unvented Attics describes the use of specific UPC SPF insulations in unvented attic assemblies without the protection of thermal or ignition barriers. Specific “End-Use Configuration” tests are described, the specific IBC/IRC code section which permit such applications and the requirements of the attic design are specifically identified. Minimum and maximum insulation thickness is also listed.

Section 5.4.4 - Use on Attic Floors describes the conditions which must be observed when applying the UPC SPF insulation material onto the floor of the attic.



JBSITE SETUP BEST PRACTICES

Upon arrival at the jobsite, the application team must ensure the jobsite is suitable, secure, and safe to conduct spray operations. A partial list of considerations is listed below and are not exhaustive; members of the installation team must maintain a safe work environment during and after spray operations:

- ◆ Park vehicles on level, non-permeable ground (concrete, asphalt) and provide spill containment absorbent “Pigs” around the perimeter of the vehicle.
- ◆ If located on level, permeable ground (gravel, earth, sand), place a non-permeable ground sheet on the ground first and locate the vehicle on the ground sheet. Provide spill containment pigs around the perimeter of the ground sheet.
- ◆ Provide sufficient spill containment material to contain a spill 2X the liquid volume transported to the jobsite.
- ◆ Locate the vehicle on stable, firm ground or hard surface. Do not position the vehicle on wet, soft earth.
- ◆ Locate the vehicle in a manner which will not block other traffic or access to or from the workplace.
- ◆ Position the vehicle within a reasonable distance from the access point to the jobsite to minimize the length of dispense hose exposed to the elements.
- ◆ Position wheel chocks on all wheels to prevent vehicle movement.
- ◆ Designate a single, highly visible, accessible location as a “Communication Post” to provide easy access to all product technical information, SDS sheets, permits and general information concerning materials being used by the SPF installation team. Include the location (address) and contact information of the nearest hospital, and emergency response teams.
- ◆ Erect hazard, warning signs and physical barricades at all worksite entry points to eliminate or manage access to the SPF application work area.
- ◆ Position ABC fire extinguishers inside the work truck, outside the work truck and in the designated spray foam work area.
- ◆ Position emergency eyewash stations inside the work truck and in the designated spray foam work area.
- ◆ Locate and store all PPE equipment and material in a single location in accordance with the manufacturer’s instructions.
- ◆ Confirm all surfaces within the isolated work area NOT intended to receive SPF insulation are fully protected from direct contact with SPF chemical or overspray.
- ◆ Determine the need for and provide any necessary fall protection equipment in accordance with OSHA Title 29 (CFR) Subpart M – *Fall Protection* and all appropriate subsections.
- ◆ Ensure potable water is available to the jobsite.
- ◆ Ensure suitable latrine facilities are available to the jobsite.
- ◆ If equipment is left on the jobsite overnight, provide suitable locked storage facilities.
- ◆ Confirm and/or establish appropriate jobsite security to prevent unrelated entry during or after normal working hours.
- ◆ Collect and remove all waste from jobsite at the end of each day.
- ◆ Provide “job card”, typically adhered to convenient framing member in attic or attached to attic hatch identifying material manufacturer, Installer/Contractor, contact information, Total R-value of installation and date of installation.



CHEMICAL STORAGE REQUIREMENTS

- ◆ Confirm all SPF chemical arriving at jobsite is provided in suitable containers provided by UPC, all labels are legible and not hidden and there are no leaking containers.
- ◆ Confirm chemical temperature is within UPC recommended storage temperature and the chemical temperature is consistent within the drum. Drums must be stored between 50°F and 75°F.
- ◆ Material should be stored off the floor to eliminate cold chemical on the bottom of drums – specifically in cold climates. Storing material on pallets or skids also allows air to circulate under the drum to help warm or cool the drum.
- ◆ Materials not immediately needed must be securely stored in accordance with UPC storage and handling recommendations.
- ◆ Do not store material in direct sunlight.
- ◆ Do not circulate or agitate SPF resin containing a blowing agent. All closed cell SPF resin contains a blowing agent.
- ◆ Band style drum heaters are not recommended to be used for closed cell resin drums. These devices produce hot spots and can result in excess pressure and drum rupture.
- ◆ Drum blankets and indirect heating is recommended for use with closed cell resin material.
- ◆ Store all flammables in designated containers in accordance with OSHA 1926.152 and local fire regulations.



ISOLATION & VENTILATION BEST PRACTICES

- ◆ For retrofit applications, ensure the attic is isolated from the living space to prevent overspray and airborne SPF particles from entering the occupied space. Confirm the HVAC system is turned "OFF".
- ◆ All home occupants and animals must be out of the home while spraying is conducted. Occupants must remain out of the home for a full 24 hrs. following the completion of SPF installation. The isolated work area is to remain under full ventilation for 24 hrs. following SPF installation.
- ◆ Erect continuous, non-permeable material to establish, isolate and identify SPF work area.
- ◆ Locate isolated work area air intake fan in accordance with Industry best practice as provided by the Spray Polyurethane Foam Alliance and American Chemistry Council – Center for the Polyurethane Industry.
- ◆ Locate isolated work area exhaust fan in a manner to draw air across the face of the work area in accordance with Industry best practice as provided by the Spray Polyurethane Foam Alliance and American Chemistry Council – Center for the Polyurethane Industry.
- ◆ Provide ventilation intake air at a minimum rate of 10 ACH within the isolated SPF work area.
- ◆ Provide ventilation exhaust air at a minimum rate of 11 ACH (10% greater than intake rate) to create a slight negative pressure within the isolated SPF work area.
- ◆ Continue ventilating the isolated work area for a period of 24 hrs. following the installation of any/all UPC polyurethane foam products when products are installed in a residential structure.



PPE REQUIREMENTS

Before working with any UPC product, you must read and understand the available information (e.g. Safety Data Sheets, Technical Data Sheets, and Industry best practices) on its risks, proper use and safe handling. All applicators and their support teams must use appropriate respiratory, skin and eye Personal Protective Equipment (PPE) in addition to construction task related protective safety gear when handling and processing spray foam systems.

Refer to the Center for the Polyurethane Industries (CPI): "Health and Safety Product Stewardship Workbook for High Pressure Application of Spray Polyurethane Foam (SPF)", "Guidance for Working with MDI: Things You Should Know", NIOSH Poster: "Got Everything Covered?", "High Pressure SPF Insulation in New Home Construction and Retrofit Application: Worker and Homeowner Health and Safety Information", which can be found on the ACC/CPI website at www.americanchemistry.com



The Spray Foam Industry trade association Spray Polyurethane Foam Alliance (SPFA) also provides Health and Safety related resources as well as SPF Professional Certification Training Programs. UPC is a contributing member to the SPFA and active participant in the development of industry standards and guides. The SPFA website is located at www.sprayfoam.org

SAFETY CONSIDERATIONS FOR ATTICS

The attic is a unique application area for SPF. A safety inspection of the entire attic must be conducted before spray foam applications begin to determine and address any safety issues present in the attic area. UPC provides several technical tips related to the application of SPF on its website.

In new construction, the area is often open to the floor or first level requiring fall protection measures be employed to meet OSHA requirements. In retrofit or new construction, the intended use of the space will dictate the level of fire protection required for the installed product. In addition, many attic spaces contain combustion appliances such as HVAC units and water heaters.

Occupants and the intended use of the attic play a key role in determining the level of fire protection required for SPF insulation. All SPF is considered combustible by the code and must be protected with a minimum approved 15-minute thermal barrier. In some limited applications, the thermal barrier requirement is relaxed to an ignition barrier or in some well-defined applications, no protection is required. These are very limited cases.



SPECIAL CONSIDERATIONS FOR ATTICS

UPC provides the following list of items to consider when insulating attics. The list is not exhaustive but is provided as a reminder.

- ♦ Attic spaces are generally not conditioned spaces and can be hot environments to work in. Be aware of the temperature and environmental conditions – stay hydrated.
- ♦ Attics often include overhead work which strains the neck, shoulders, and arms. Be aware of light-headedness and rest often.
- ♦ Attics often present angles, corners and areas which are difficult to insulate. Do not "over-pack" or "fill" hard to reach areas as this may exceed the maximum recommended pass thickness for the specific system and result in hazardous thermal decomposition of the insulation.



- ◆ PVC/cPVC and electrical wires are often encountered in attics. Follow the UPC recommendations when installing SPF around or onto these plastic substrates.
- ◆ Ductwork not intended to be insulated and mechanicals must be properly protected from overspray.
- ◆ Protect all surfaces not intended to be insulated from overspray.
- ◆ Protect all surfaces from contact with dispense hose when attic access is restricted to the internal attic hatch (retrofit application)
- ◆ Use caution when walking in attics. The ceiling of the lower floor is NOT a suitable walking surface and will NOT support weight.
- ◆ Wear a hard hat or bump cap to protect your head from accidental contact with truss and low hanging framing members.

SUBSTRATE PREPARATION

Framing members, flooring and sheathing materials are common substrates for attic insulation applications. Generally, wood, or wood-based products are the most common framing and sheathing materials and gypsum the most common flooring material.

In all cases, the substrate must be free of oil, grease, process films and release agents, waxes, rust scale, frost, mold, loose dirt or dust and the moisture content of substrates must be below 19% before applying any UPC SPF product. Substrate temperature should always be a minimum of 5°F above the ambient air dew point. UPC recommends the use of a test area to evaluate the adhesion of SPF to the substrate.

The suitability of the substrate for the application of UPC SPF is at the discretion of the applicator.

Metal substrates may require a primer coating be applied before the application of SPF. Galvanized metals are particularly troublesome and must always be primed before the application of SPF.

PVC and cPVC piping may be present in the attic. UPC provides specific documentation for the application of SPF to plastic piping. Please read and understand the requirements for the application of SPF to PVC and cPVC piping.

Gypsum board uses a paper facing which may have a higher moisture content than the gypsum core. When testing a gypsum board substrate for moisture content, be sure to test the paper surface and not the gypsum core.





UNIVERSAL POLYMERS CORPORATION

A Division of General Manufacturing Coatings Corp.

Always protect surfaces not intended to be insulated from overspray before beginning the application of SPF or Primers.


In attic applications, there are many substrates which may be encountered. The use of primers in specific conditions may be warranted. If adhesion of SPF to typical attic substrates is in question, prepare a test area and conduct an adhesion test using ABAA T0002-2019 Pull Adhesion Test Method. The adhesion of the closed cell SPF to the substrate must be greater than 15 lb/in²

To increase the adhesion of all SPF products to the substrate a suitable primer may be used. Application area ventilation and proper PPE must be used when applying primers to avoid inhalation. UPC recommends the use of water-based primer materials – avoid combustible primer application in the attic. Follow manufacturers application guidelines when applying any primer. Avoid excessive application thickness.

UPC supports the development of industry standard documents and industry best practices found on the SPF trade association website at www.sprayfoam.org.

When applying closed cell foam to engineered wood products, there may be a waxy surface on the substrate. These materials include but are not limited to; Laminated veneer lumber (LVL) beams, oriented strand board (OSB) sheathing and wood I-Joists.

On behalf of the SPF industry, the SPFA conducted extensive testing evaluating several options thought to improve adhesion of SPF to LVL beams. The results are provided below. Your results may vary. The use of primers or other means of apparent adhesion promoters and the final condition and suitability of the substrate is at the discretion of the installer/applicator.

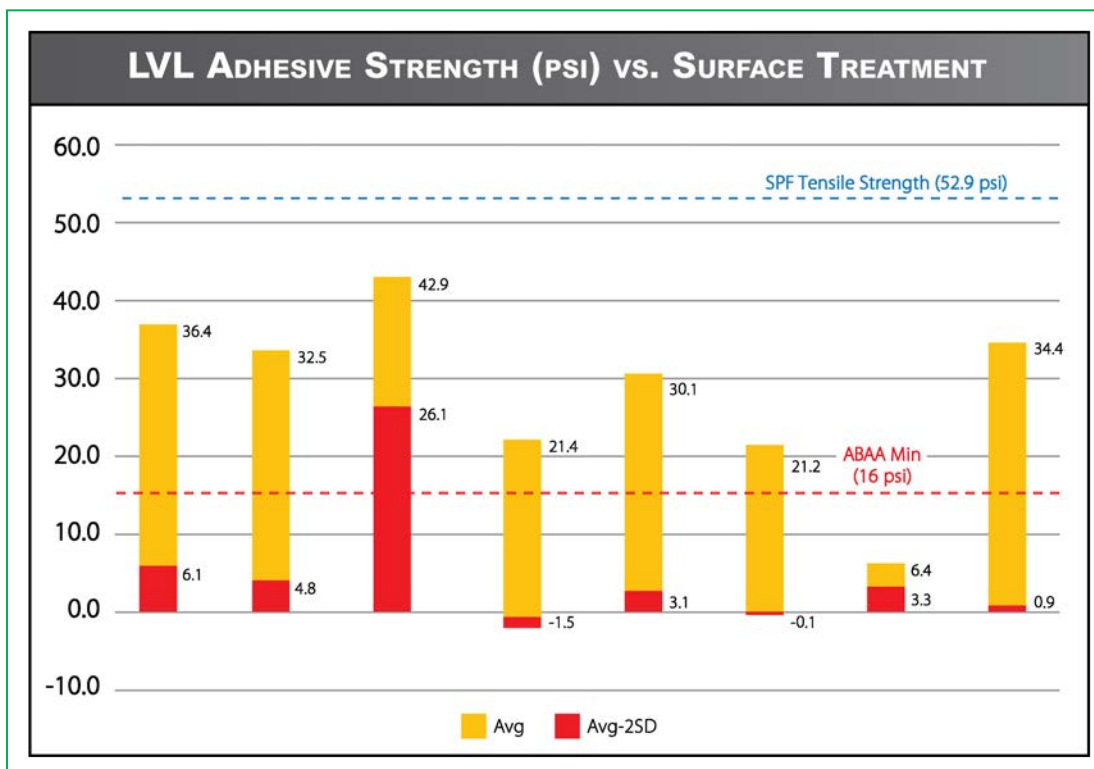



UNIVERSAL POLYMERS CORPORATION

A Division of General Manufacturing Coatings Corp.

ID	NAME	SUBSTRATE CONDITION
A	Control #1	Smooth (waxy) LVL Surface
B	Control #2	Rough OSB Surface
C	Primer #1	Modified Acrylic Adhesion Primer (off-the-shelf e.g., Kilz® Adhesion)
D	Mech #1	80 Grit Sandpaper on Belt Sander
E	Mech #2	Curry Comb Scuff
F	Fabric #1	BIBS Fabric (non-woven PE), T-50 x ½" Staples on 2" Grid
G	Fabric #2	Weather Resistant Barrier (Tyvek), T-50 x ½" Staples on 2" Grid
H	Flash Coat	Apply ½" SPF Sacrificial Pass and Remove; Apply Final Pass of SPF

ENVIRONMENTAL LIMITATIONS

Each UPC SPF chemical system has been specifically formulated for application within an ambient temperature range, humidity range and substrate temperature range. Please refer to the product Technical Data Sheet for information regarding Processing Instructions for the specific foam system.

The following chart is provided for your guidance.

REACTION SPEED	AMBIENT TEMPERATURE	SUBSTRATE TEMPERATURE
Regular		
Summer		
Winter		

In all cases, when substrate temperatures are below 45°F, pre-heat the building to a temperature above 45°F (in the case of metal substrates, limit pre-heating to no more than 55°F to prevent condensation from forming).

Do not heat enclosures with propane fueled heaters. This type of fuel adds substantial moisture to the air and may result in condensation forming on the substrate.

Protect installed foam from UV (sunlight) exposure with a suitable, approved coating.

Not intended for use where direct contact for extended periods of time with liquid water is expected.



LIMITATION OF USE SUMMARY

UPC produces polyurethane foam resin formulations in several ISO 9001:2015 certified facilities. With any polyurethane foam material there are limitations of use for both the chemical (resin and Isocyanate) and finished foam insulation. The following list does not include all limitations. Please read and understand all UPC technical and safety information provided on the UPC website and packaging labels. In addition, please read and understand the information provided by Industry Trade Association websites.

- ◆ Do not allow foam insulation to enter or be installed in electrical boxes, electrical junction boxes or connection boxes.
- ◆ Do not exceed the “continuous service temperature” of the specific foam formulation you are installing.
- ◆ Maintain minimum clearance of 3 inches between recessed lighting and other heat sources (chimney, flue, steam pipe, etc.).
- ◆ Maintain correct chemical storage conditions as stated on the chemical container and current Technical Data Sheet for the foam system.
- ◆ Do not process chemical system outside recommended ambient conditions specific to the chemical system being installed.
- ◆ Do not install SPF in an area which may experience extended periods of liquid water contact.
- ◆ Do not exceed “single pass thickness” requirements for the specific chemical system as stated on the current Technical Data Sheet.
- ◆ Protect the installed foam insulation from sunlight.
- ◆ SPF must always be protected from fire with an approved, 15-minute minimum thermal barrier unless specifically allowed by local building code and AHJ.
- ◆ Do not install UPC SPF materials over flexible ductwork.
- ◆ Do not install UPC SPF materials in passes less than 1 inch thick.
- ◆ UPC open cell SPF insulation is not a vapor retarder and must be protected with a minimum type II vapor retarder when used in attic applications in climate zone 4a marine and above.
- ◆ UPC closed cell SPF insulation is not intended for use as a caulk or sealant around window units. Excessive pressure may restrict window operation or result in damage to the window glazing.
- ◆ Do not use without proper PPE.
- ◆ Do not use without properly isolated and ventilated workspace.





START UP & SHUT DOWN PROCEDURE

Equipment manufacturers provide detailed instructions regarding the use and maintenance of the equipment. UPC recommends attending the appropriate training course for the specific equipment intended for use.



YIELD CALCULATION

The yield of SPF insulation may be defined as “the area covered by a known quantity of chemical material at a defined thickness”. In mathematical terms it is Area divided by Consumption at a defined thickness.

Yield = Area / Consumption

Consumption: The amount of chemical used must be accurately determined. The preferred method is by “cycles” as the pump volume is fixed, known and consistent. Each proportioner is equipped with fixed volume pumps and the volume is prescribed in the owner’s manual. The table below with common equipment types is provided for your convenience.

	E-20	E-30	H-30	H-40
Output Per Cycle	0.0104 gal.	0.0272 gal.	0.074 gal.	0.063 gal.

A “set” of chemical (A and B drums) is often used as the “unit” of consumption. This will lead to inaccurate yield calculations as a “set” volume varies from formulation to formulation and manufacturer to manufacturer. Each drum fill weight also varies from formulation to formulation and manufacturer to manufacturer. Measuring the height of the chemical in the drum is also not accurate as the height of the chemical will vary with temperature and the diameter of the drum is not consistent. Measuring the change in liquid height with a measuring tape and then converting the linear measurement to lbs. is complicated and doesn’t consider the materials specific gravity (ratio of the density of the liquid compared to the density of water).

Each cycle of the pump is registered on the cycle counter. When determining yield, set the cycle counter to zero and begin spraying. Once the known area is insulated, record the number of cycles indicated on the cycle counter.

Area: The length and height of the test area must be accurately measured. Do not include framing members, windows, doors or penetrations in the calculation. Measure ONLY the area to be insulated. To eliminate variables, use an area without studs, or framing and few/no penetrations as your test area.



Thickness: The average thickness of the insulation in the test area must be accurately determined. Take several measurements to determine average thickness over the entire installed area of insulation. Measure and record the thickness to the nearest 1/8th inch. Here is an example:

Convert the number of cycles to lbs. of chemical system.

We know the number of strokes and the volume of the cylinder. Multiply these two numbers together to get the volume of chemical consumed for our known area.

$$\circ (\# \text{ of strokes}) \times (\text{Volume of Cylinder}) = \text{Total Volume of Chemical Consumed}$$

For Example, if our equipment is a Graco Reactor E-30 with standard pumps:

Here is the information we noted from our test.

- ◆ Graco Reactor 2 E-30
 - ◆ 854 Cycles
 - ◆ UPC 2.0 HL HFO chemical system
 - Average Specific Gravity = 1.23
 - *1.23 is the average specific gravity between the A-side and B-side specific gravity provided on the system Technical Data Sheet
 - ◆ Area = (60 ft. long X 12 ft. high) X 1.5 inches thick = 1,080 board ft.
- 1) Calculate the lbs. of chemical consumed:
 - 854 cycles X 0.0272 gal/cycle = 23.23 gallons of system (A & B combined)
 - *0.0272 gal/cycle is provided by the Graco Reactor 2 E-30 manual
 - 2) Convert the gallons of system to lbs. of system
(Use the specific gravity number to do this)
 - 23.23 X ((8.34 lbs. ÷ gal) X 1.23) = 238.3 lb.'s of chemical system
 - *8.34 is the number of lb.'s / gal of water
 - 3) Divide the Total Area (board feet) by Total Chemical Consumption (lbs.)
 - 1,080 Brd ft. ÷ 238.3 lb.'s = 4.53 Brd. ft/lb.
 - Use the "net weight" of the material in the A + B drum to give you "set weight" (see drum label)
 - 4) Multiply the set weight by the yield/lb. value
- Total Net Weight of set X 4.53 = Yield per set
- In this example, the set of 2.0 HFO is yielding: 1,000lbs x 4.53 = 4,530 Brd Ft.



FACTORS EFFECTING YIELD

There are many factors which impact yield. Here is a short list of the major factors and their influence, positive or negative, on the yield of SPF chemicals. See UPC's *"Maximizing Yield"* flyer for more information select Tech Tips at UPCFoam.com.

Density: In general, the lower the density, the higher the yield. Remember the skins (top surface of a pass and the foam contact surface) are higher density material and will negatively impact yield.

Environmental Temperature: The lower the temperature, the lower the yield. This is due to heat energy needed for the reaction of SPF being drawn away from the foam chemical and into the surrounding environment.

Substrate Temperature: Most applications in the attic are onto exterior sheathing, either roof sheathing or wall sheathing. Exterior sheathing is exposed to the environmental elements and may be at a different temperature than the interior space of the attic. If the substrate temperature is below the recommended lower limit specified by UPC for the specific chemical system, the chemical reaction will be slowed, and the yield of the system negatively impacted.

Processing Temperatures: UPC provides recommended processing temperatures for each SPF system. Processing UPC material outside those recommendations may negatively impact system yield.

Number of Passes: Minimize the number of passes. Maximum allowable pass thickness is identified on the system Technical Data Sheet.

Application Technique: It's recommended to spray into the rising foam front, to overlap the previous pass by approx. 70% while the foam is still rising. In open stud bays or roof truss assemblies, if long passes are used, at least 50% of the liquid foam is applied to foam which has past the tack free stage. This results in a pass-line and thin pass thickness which adds overall density and negatively affects yield.

APPLICATION TECHNIQUE (INDUSTRY BEST PRACTICE: HIGH LIFT VS. REGULAR)

Whenever possible, the application of SPF chemical should be "into the rising foam" in order to eliminate the potential for pass-lines within the foam and maximize yield. In attic applications, much of the foam insulation is installed overhead or from scaffolding. Attention to general overhead safety and the use of scaffolds is highly recommended.

When spraying UPC foam insulation from scaffolding, it is recommended to install the maximum recommended pass thickness stated on the material Technical Data Sheet onto the entire reachable surface area before adding the next pass. This technique provides time to allow the first pass to cool before applying subsequent passes and minimizes the number of times the scaffolding needs to be moved.

When spraying UPC high lift formulations, it is recommended to adjust the application technique from 70% overlap to 50% overlap in order to move the liquid in front of the rising foam rather than applying high volumes of liquid onto the rising foam in order to avoid disrupting cell formation. As always, install the required thickness or maximum allowable thickness as stated on the material Technical Data Sheet in a single pass.

- ◆ Refrain from flash-coating the top surface to even out the surface profile.
- ◆ Refrain from filling in the top surface edges of stud and truss bays.
- ◆ Always confirm applied foam thickness with a depth gage before relocating scaffolding.
- ◆ Flash the small hole left by the depth gage before relocating scaffolding.



THICKNESS OF PASS LIMITATIONS

Heat is generated during the chemical reaction during the development of the final foam insulation. As SPF is such a good insulation, this heat dissipates slowly. The internal foam temperature of each recommended pass thickness has been measured and the maximum allowable recommended pass thickness determined. UPC provides the maximum allowable pass thickness for each foam system on the appropriate Technical Data Sheet.

The table below summarizes the current SPF systems recommended maximum pass thickness.

	2.0 HL HFO	2.0 Regular	2.0 HL HFC	1.7 Regular	500 Classic	500 Max	500 Max Pro	500 OCX
Maximum Pass Thickness	5.0 in.	2.0 in.	4.5 in.	2.0 in.	6-8 in.	6.0 in.	10 in.	6.0 in.

Once the installed foam has become hard to the touch (surface cure) a second pass may be applied.

Care must be taken with the application of "High-Lift" closed cell foam formulations to control the foam thickness and assure the finished thickness is at or below the maximum recommended pass thickness. UPC recommends the use of multiple 3-inch passes be installed onto each other until the final foam thickness is achieved. This technique will improve cell structure, reduce the potential for shrinkage and substrate delamination, improve thickness control, and improve system yield while providing the productivity advantages associated with High-Lift formulations.

QUALITY ASSURANCE TESTING PROCEDURES

UPC delivers a fully tested and approved chemical blend from its ISO 9001:2015 series production facilities. We provide installer training and fully support the development of industry best practices. To assure a high-quality installation, UPC provides a "Quality Assurance" form for use by our contractor/installers to gather critical information concerning the installed product. UPC recommends the completion of the Quality Assurance form for each site, each day, and each time a new lot number of chemical material is installed.

Installed product testing includes the following:

Installed Foam Thickness

- ◆ Confirm installed thickness with physical probe inserted through SPF to substrate
- ◆ Conduct thickness checks frequently
- ◆ Report installed thickness, maximum pass thickness, and number of passes on daily work report
- ◆ Report Installed R-Value on Installation Report Card to be conveniently located at jobsite



Density Determination

- ◆ Before beginning to install UPC closed cell SPF each day, each change of material lot number and at new sites, perform a foam density test in accordance with ASTM D 1622 – water displacement method
- ◆ Record density on Daily Work Report

Adhesion Determination

- ◆ Confirm the adhesion of UPC closed cell SPF to any substrate, each day, change of material lot number and at new sites or when the adhesion of foam to the substrate is questionable

Void Detection

- ◆ Used predominantly for open cell foam installations, use a coring tool to remove a core sample through the foam to the substrate
- ◆ Inspect the sample for interlaminar voids (pass-to-pass) and loss of adhesion to the substrate
- ◆ Repair sample void with like material

Cell Structure (Visual)

- ◆ Confirm consistent and regular cell structure throughout the application thickness with visual inspection
- ◆ Use a coring tool to remove a core sample through the foam to the substrate

Sample Collection

- ◆ UPC recommends installers collect, tag and store core samples in a sealed plastic bag, in a dark, cool location for a minimum of 1 year
- ◆ Samples must be labeled with the installation date, jobsite location, area the sample was taken, manufacturer and material lot number
- ◆ Repair all sample voids with like material
- ◆ The Quality Assurance form can be found at upcfoam.com in the Technical Resources Section under Forms. Look for the “UPC Quality Assurance Program”.

Contractor/Applicator Resources

▼ Jobsite Tools

^ Forms

UPC Insulation Certificate for Installed Foam – Fillable

UPC Limited Lifetime Residential Insulation Warranty

Not Approved For Storage UPC fillable



UPC Quality Assurance Program 092920

▼ Tech Tips

▼ Safety Documents



TROUBLESHOOTING

Attic applications are subject to additional considerations regarding safety, ventilation, and application thickness control. Beyond those, the application of UPC SPF may encounter.

- ◆ Delamination from the substrate which may be a result of excess contamination on the substrate. In attic applications contaminants may include, dust, frost, substrate moisture content greater than 19% and loose substrate material. The acceptability of any substrate as suitable for the application of UPC SPF is at the discretion of the applicator.
- ◆ Interlaminar (between passes) blisters are not common in attic applications and may be a result of slow reacting foam on the edge of a pass where the foam thickness is less than ½ inch thick – specifically in cool/cold ambient conditions. The foam chemical does not have enough mass (amount of chemical) to “drive” the reaction in cold conditions and the reaction is slowed. When more chemical is sprayed over the top, the reaction is suddenly energized, and gas is released. This excess gas results in a blister. Changing the reactivity grade of the chemical system to a faster speed will eliminate the issue. (Regular Grade to Winter Grade)
- ◆ Elongated cells in the center of the closed cell foam pass may result in shrinkage (delamination) or cracking in the middle of the pass between framing members. This is an indication of excessive single pass thickness. Reduce the pass thickness.
- ◆ Poor cell structure throughout the foam is an indication of resin contamination as a result of improper change-over practice. Chasing one resin with another is not recommended. Attempting to process resin material which is past the stated shelf-life of the material will also result in poor quality foam insulation. Always install UPC SPF material within the recommended shelf-life as stated on the drum label and system Technical Data Sheet.
- ◆ Friable surface foam (powder, chalk, crispy) is an indication of an incomplete reaction typically caused by applying the foam system outside the recommended environmental window for the specific system (usually in too cold conditions). Friable surface foam will have reduced adhesion to the substrate resulting in separation from the framing members. Change the closed cell resin to a colder temperature grade.
- ◆ Excessive dispense head clogging is a result of high temperature processing. Reduce the chemical heaters and hose heater until processing improves. UPC SPF systems are designed to be installed with a minimum of down-time.
- ◆ Spurts of “A” or “B” side chemical at the dispense head are a result of pump cavitation and will result in poor quality foam product, areas of off-ratio foam and must be corrected immediately. *Resin pump* cavitation may be caused by cold resin material – improper chemical temperature which causes the resin to thicken and not flow easily through the transfer pump or supply lines. Confirm the resin drum and chemical temperatures are within the proper temperature range (55°F–75°F) stated on the drum label or the specific chemical system Technical Data Sheet. Isocyanate pump cavitation may be caused by dirty chemical filters on the supply side of the isocyanate delivery assembly. Filters must be maintained regularly to assure proper equipment function.



MATERIAL CHANGE OVER PROCEDURE


Isocyanate from one manufacturer may be different than the isocyanate from another manufacturer. The correct isocyanate must be paired with the identified resin from a single manufacturer. Each chemical system has been extensively tested as a matched pair of A-side and B-side. Mixing one supplier's resin with a different supplier's isocyanate is never permitted.

When handling polyurethane foam chemicals and axillary chemicals (solvents, primers, etc.), always read and understand the material Safety Data Sheet (SDS), wear all required PPE and conduct material change-over operations in a well-ventilated area.

UPC does not recommend "chasing" one resin after another without using a flushing solution and/or air. Today's equipment is a complex network of small openings and chambers which hold residual chemical. Delivery hoses often have a convoluted core to help the hose bend. These convolutions trap chemical. Open cell resin is simply not compatible with closed cell resin and any amount of closed cell resin will contaminate open cell resin and open cell resin will contaminate closed cell resin. The resulting foam is not suitable for application under any circumstance. Every effort must be made to keep the two resins apart from each other and make sure the dispensing equipment is completely clean before charging the system with the different resin. The following procedure is recommended under the following circumstances.

- ◆ Changing from Open Cell to Closed Cell Resin
- ◆ Changing from Closed Cell to Open Cell Resin
- ◆ Changing from one resin manufacturer to another

In general terms, this is the concept behind our changeover procedure.

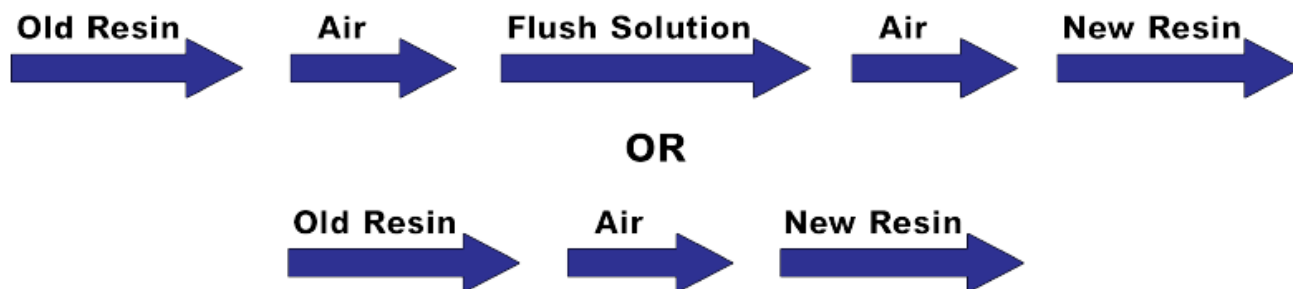

IMPORTANT NOTICE: Before beginning any operation, which may expose you to any chemical, wear appropriate PPE, including but not limited to face shield, splash goggles, gloves, skin protection, Tyvek suite, cartridge respirator. Conduct operation near eye wash and emergency body shower location. Read and understand all material SDS. Material may be under pressure, use caution.



CHANGEOVER WITH AIR ONLY

Step 1 ***Purging B-side Supply Lines***

- ◆ Disconnect the air supply to the pump
- ◆ Open the Recirculation valve
- ◆ Drain transfer pump fluid section by fully depressing the ball valve at the bottom of the pump
- ◆ Drain the material wetting cup section of the pump by inverting the pump over a collection bucket
- ◆ Once fully drained, close pump air valve and reconnect supply air
- ◆ Place pump in clean, open top, empty pail and secure pump
- ◆ Open B-side relief valve and slowly open transfer pump air valve
- ◆ Slowly cycle transfer pump to draw air into the pump and push resin chemical through return line into old resin drum
- ◆ Once air is heard exiting the return line, close B-side relief valve

Step 2 ***Switching Chemical***

The procedure will be different whether you have a recirculating block or not.

Without Recirculating Block

- ◆ Clean and dry wet section of transfer pump
- ◆ Slowly insert transfer pump into new B-side material. Be gentle as agitation may cause closed cell resin to froth
- ◆ Secure gun manifold over open large bung of old resin drum and slowly open manifold resin valve
- ◆ Drain hose chemical into old B-side drum until air escapes from manifold (15-20 minutes)
- ◆ Close manifold B-side valve
- ◆ Into properly labeled "waste container" open manifold B-side valve and allow the remaining air in the hose assembly to escape
- ◆ When new chemical is draining from hose assembly, continue until liquid is clean and free of entrapped air
- ◆ Close B-side manifold valve
- ◆ Dispose of "waste" material in accordance with UPC resin material SDS

With Recirculating Block

- ◆ Clean and dry wet section of transfer pump
- ◆ Slowly insert transfer pump into new B-side material. Be gentle as agitation may cause closed cell resin to froth
- ◆ Connect gun manifold to recirculating block and open manifold and recirculating block B-side valves
- ◆ Drain hose chemical into old B-side drum until air escapes from manifold (15-20 minutes)
- ◆ Into properly labeled "waste container" open manifold B-side valve and allow the remaining air in the hose assembly to escape



- ◆ When new chemical is draining from hose assembly, continue until liquid is clean and free of entrapped air
- ◆ Close B-side manifold valve
- ◆ Dispose of "waste" material in accordance with UPC resin material SDS

CHANGEOVER WITH AIR + FLUSHING SOLUTION

Step 1 *Purging B-side Supply Lines*

- ◆ Disconnect the air supply to the pump
- ◆ Open the Recirculation valve
- ◆ Drain transfer pump fluid section by fully depressing the ball valve at the bottom of the pump
- ◆ Drain the material wetting cup section of the pump by inverting the pump over a collection bucket
- ◆ Once fully drained, close pump air valve and reconnect supply air
- ◆ Place pump in clean, open top, empty pail and secure pump
- ◆ Open B-side relief valve and slowly open transfer pump air valve
- ◆ Slowly cycle transfer pump to draw air into the pump and push resin chemical through return line into old resin drum
- ◆ Once air is heard exiting the return line, close B-side relief valve

Step 2 *Adding Flushing Solution*

The procedure will be different whether you have a recirculating block or not.

Without Recirculating Block

- ◆ Clean and dry wet section of transfer pump
- ◆ Slowly insert transfer pump into flushing solution
- ◆ Secure gun manifold over open large bung of waste resin drum and slowly open manifold resin valve
- ◆ Drain hose chemical into waste resin drum until flushing solution escapes from manifold (15-20 minutes)
- ◆ Close manifold B-side valve
- ◆ Into properly labeled "waste container" open manifold B-side valve and allow the remaining air in the hose assembly to escape
- ◆ When flushing solution is draining from hose assembly, continue until liquid is clean and free of entrapped air
- ◆ Close B-side manifold valve
- ◆ Dispose of "waste" material in accordance with UPC resin material SDS

With Recirculating Block

- ◆ Clean and dry wet section of transfer pump
- ◆ Slowly insert transfer pump into flushing solution.
- ◆ Connect gun manifold to recirculating block and open manifold and recirculating block B-side valves



- ◆ Drain hose chemical into waste resin drum (15-20 minutes)
- ◆ Into properly labeled "waste container" open manifold B-side valve and allow the remaining air in the hose assembly to escape
- ◆ When flushing solution is draining from hose assembly, continue until liquid is clean and free of entrapped air
- ◆ Close B-side manifold valve
- ◆ Dispose of "waste" material in accordance with UPC resin material SDS

Step 3 *Flush with Air*

- ◆ Disconnect the air supply to the pump
- ◆ Open the Recirculation valve
- ◆ Drain transfer pump fluid section by fully depressing the ball valve at the bottom of the pump
- ◆ Drain the material wetting cup section of the pump by inverting the pump over a collection bucket
- ◆ Once fully drained, close pump air valve and reconnect supply air
- ◆ Place pump in clean, open top, empty pail and secure pump
- ◆ Open B-side relief valve and slowly open transfer pump air valve
- ◆ Slowly cycle transfer pump to draw air into the pump and push resin chemical through return line into old resin drum
- ◆ Once air is heard exiting the return line, close B-side relief valve

Step 4 *Switching Chemical*

The procedure will be different whether you have a recirculating block or not.

Without Recirculating Block

- ◆ Clean and dry wet section of transfer pump
- ◆ Slowly insert transfer pump into new B-side material. Be gentle as agitation may cause closed cell resin to froth
- ◆ Secure gun manifold over open large bung of old resin drum and slowly open manifold resin valve
- ◆ Drain hose chemical into old B-side drum until air escapes from manifold (15-20 minutes)
- ◆ Close manifold B-side valve
- ◆ Into properly labeled "waste container" open manifold B-side valve and allow the remaining air in the hose assembly to escape
- ◆ When new chemical is draining from hose assembly, continue until liquid is clean and free of entrapped air
- ◆ Close B-side manifold valve
- ◆ Dispose of "waste" material in accordance with UPC resin material SDS

With Recirculating Block

- ◆ Clean and dry wet section of transfer pump
- ◆ Slowly insert transfer pump into new B-side material. Be gentle as agitation may cause closed cell resin to froth
- ◆ Connect gun manifold to recirculating block and open manifold and recirculating block B-side valves



UNIVERSAL POLYMERS CORPORATION

A Division of General Manufacturing Coatings Corp.

- ◆ Drain hose chemical into old B-side drum until air escapes from manifold (15-20 minutes)
- ◆ Into properly labeled "waste container" open manifold B-side valve and allow the remaining air in the hose assembly to escape
- ◆ When new chemical is draining from hose assembly, continue until liquid is clean and free of entrapped air
- ◆ Close B-side manifold valve
- ◆ Dispose of "waste" material in accordance with UPC resin material SDS

DRUM DISPOSAL

- Do not remove empty drums from the worksite for personal use.
- Do not remove tops or bottoms or use a torch (open flame) in contact with either resin or isocyanate drum.
- Remove all material labels.
- Puncture all empty drums to eliminate possible reuse (*never use the drum for a fire barrel*).
- Always wear appropriate PPE when handling SPF chemicals.
- Read and understand material Safety Data Sheet available on UPC website.
- "A"-side drums must be neutralized before disposal. A neutralizer solution consists of 2% liquid detergent, 5-10% sodium carbonate or 3-8% concentrated aqueous ammonia and 80% water. Take care to avoid exposure to high concentrations of ammonia vapor. Neutralizer solution can be stirred rapidly into the waste isocyanate in a well-ventilated area. Keep the drum open and remove all closure bungs. Allow mixture to stand 48 hrs. Separate solid waste from liquid. The collected neutralizer solution may be stored and reused. The solid waste may be considered hazardous waste. Confirm material status with your local landfill authority.
- "B"-side Resin an "A"-side Isocyanate drums can be recycled at a DOT certified recycling center. There are three options for empty drums which contained "A"-side, Isocyanate or MDI:
 - ◆ Offer the drums to a Department of Transportation (DOT) certified reconditioner for recycling
 - ◆ Dispose of the drums in a municipal solid waste landfill, unless MDI is considered a hazardous waste in the state
 - ◆ Dispose of drums through an RCRA-permitted Hazardous Waste Incinerator if MDI is considered a hazardous waste in the state



CHEMICAL WASTE DISPOSAL

Always wear appropriate PPE when handling SPF chemicals

Small quantities of resin (B-side) and isocyanate (A-side) can be mixed together in an open top container such as a bucket or large plastic bag. The chemicals will react with each other very quickly and produce heat. Keep quantities small to avoid excessive heat build-up. Avoid inhaling any vapors produced. Mix chemicals in a well-ventilated area. Once cool, cut the resulting foam mass in quarters to confirm complete reaction (no liquid material remains) and the material has cooled. Once the reaction product has completely cooled, it can be disposed of in a landfill.





SPILL CONTAINMENT AND CLEAN-UP

- Wear appropriate PPE during all spill containment and material cleanup operations.
- For small spills, soak up with noncombustible absorbent material (sand, earth, vermiculite) and transfer to a container for disposal according to local/national regulations. Clean contaminated area thoroughly.
- For large spills, contain spill with absorbent pigs or dyke constructed from noncombustible absorbent material.
- Treat spill area with decontaminant solution using 10 parts of decontaminant solution to 1 part spill and allow to react for a minimum of 30 minutes.
- Soak up all material with noncombustible absorbent material. Let stand for 30 minutes.
- Shovel into open-top container and add decontaminant solution, mix and let stand for 24 hrs.
- Cover and dispose as solid waste at approved waste disposal center.
- Refer to product Safety Data Sheet section 6 for more information.

CONTACT AND LINKS

UPC Technical Service www.upcfoam.com	203.760.0025
UPC Customer Service www.upcfoam.com	682-503-8069
Chemtrec Emergency Response www.chemtrec.com	800-424-9300
Spray Polyurethane Foam Alliance (SPFA) www.sprayfoam.org	800-523-6154
Occupational Safety and Health Association (OSHA) www.osha.gov	800-321-6742
Center for the Polyurethane Industry (CPI) www.americanchemistry.com/industry-groups/center-for-the-polyurethanes-industry-cpi	800-321-6742